



SVERKER 750™ / 760™

Relay Test Unit

The Sverker 750/760™ Relay Test Unit is the engineer's toolbox. The control panel features a logical layout, still SVERKER 650™ users will find it comfortably familiar and will be able to start work right away.

The SVERKER 750/760™ features many functions that make relay testing more efficient. For example, its powerful measurement section can display (in addition to time, voltage and current) Z, R, X, S, P, Q, phase angle and $\cos \phi$. The voltmeter can also be used as a 2nd ammeter (when testing differential relays for example). All values are presented on a single easy-to-read display.

You can also test directional protective equipment efficiently by means of the built-in variable voltage source. In SVERKER 760™ this has a continuous phase shift function as well. Automatic reclosing devices can also be tested – just as easily.

Designed to comply with EU standards and other personal and operational safety standards, SVERKER 750/760™ is also equipped with a serial port for communication with personal computers and the PC software SVERKER Win™. Since the compact SVERKER™ weighs only 18 kg (39 lbs), it's easy to move from site to site.

Two or more SVERKER™ units can also be synchronized, which for example allows the user to connect three SVERKER™ into a basic 3-phase test set.

APPLICATION

Relay Testing

SVERKER 750/760 is intended primarily for secondary testing of protective relay equipment. Virtually all types of single-phase protection can be tested.


SVERKER 750/760 is able to test three-phase protection that can be tested one phase at a time, and also a number of protective relay systems that require phase shifting. Moreover, automatic reclosing devices can be tested.

| Examples of what SVERKER 750/760 can test: | IEEE No. |
|---|----------|
| Overcurrent relays | 50/76 |
| Inverse time overcurrent relays | 51 |
| Undercurrent relays | 37 |
| Ground fault relays | 50 |
| Directional overcurrent relays | 67 |
| Directional ground fault relays | 67N |
| Overvoltage relays | 59 |
| Undervoltage relays | 27 |
| Directional voltage relays | 91 |
| Directional power relays | 32 |
| Power factor relays | 55 |
| Differential protection (differential circuits) | 87 |
| Distance protection equipment (phase by phase) | 21 |
| Negative sequence overcurrent relays | 46N |
| Motor overload protection | 51/86 |
| Automatic reclosing devices | 79 |
| Tripping relays | 94 |
| Voltage regulating relays | |
| Overimpedance relays, Z> | |
| Underimpedance relays, Z | |
| Thermal relays | |
| Time-delay relays | |

OTHER FIELDS OF APPLICATION

- Plotting excitation curves
- Current and voltage transformer ratio tests
- Burden measurement for protective relay test equipment
- Impedance measurement
- Efficiency tests
- Polarity (direction) tests

APPLICATION EXAMPLE

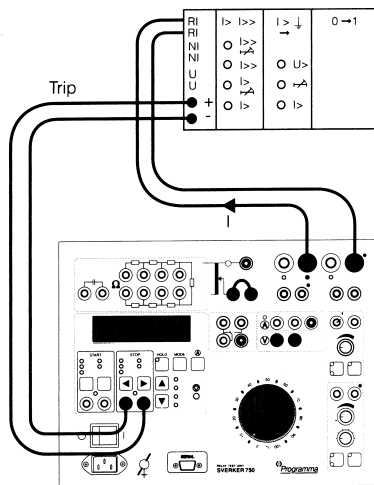

Testing the pick-up and drop-out (SVERKER 760)

1. Connect as shown in the diagram.
2. Select stop conditions, dry or wet contact.
3. Select **HOLD** to freeze the current reading.
4. Press button **SEL**/ $\text{\textcircled{A}}$ until you get a red light at the built-in ammeter. **Note!** Maximum allowed current through the separate ammeter used in this connection example is 6 A. The other measurement points do not have this limitation.
5. Press the **MODE** button.
6. Use the key \blacktriangledown to select Ω , φ , **W**, **VA**...
7. Press **CHG** (Change)
8. Select φ ($^\circ$, **Iref**) or ($^\circ$, **Uref**) by using the key \blacktriangledown .
9. Press **SEL** (Select)
10. Press **ESC**
11. Set the voltage amplitude with the upper small knob.
12. Make sure the main knob is set to **0**.
13. Turn on the SVERKER output by activating **ON** using the start switch \blacktriangledown .
14. Set the phase-angle. Use the lower knob for fine adjustment, and the middle knob for step of 90° .
Note! A small current flowing in the circuit is required to measure the phase angle.
15. Increase the current to 1.5 times the pick-up value.
16. Invoke the **ON+TIME** state by means of the start switch. The outputs will now remain turned on until the protective relay equipment operates.
17. Read the time from the display. Check also the high current setting using the same procedure.

Testing the operation time

SPECIFICATIONS

AC Current outputs

| Range | No-load voltage (min) | Full-load voltage (min) | Full-load current (max) | Load/unload times On (max)/Off (min) |
|---------|-----------------------|-------------------------|-------------------------|--------------------------------------|
| 0-10 A | 90 V | 75 V | 10 A | 2/15 minutes |
| 0-40 A | 25 V | 20 V | 40 A | 1/15 minutes |
| 0-100 A | 10 V | 8 V | 100 A | 1/15 minutes |
| 0-100 A | 10 V | - | 250 A | 1 sec/5 minutes |

The output transformer is equipped with built-in temperature protection. The primary side is protected by a miniature circuit breaker.

AC/DC outputs

| Range | No-load voltage (min) | Full-load voltage (min) | Full-load current (max) | Load/unload times On (max)/Off (min) |
|------------|-----------------------|-------------------------|-------------------------|--------------------------------------|
| 0-250 V AC | 290 V | 250 V | 3 A | 10 min/45 min |
| 0-300 V DC | 320 V | 250 V | 2 A | 10 min/45 min |

Separate AC voltage output SVERKER 750

| Range | No-load voltage (min) | Full-load voltage (min) | Full-load current (max) |
|-------------|-----------------------|-------------------------|-------------------------|
| 0-60 V AC | 70 V | 60 V | 0.25 A |
| 60-120 V AC | 130 V | 120 V | 0.25 A |

Both ranges are divided into voltage steps of 10 V that are steplessly variable.

Separate AC voltage output SVERKER 760

| Range | No-load voltage (min) | Full-load voltage (min) | Full-load current (max) |
|-------------|-----------------------|-------------------------|-------------------------|
| 0-140 V AC | 165 V | 140 V | 0.25 A/cont. |
| Phase angle | Resolution | Accuracy | |
| 60-120 V AC | 130 V | 120 V | |

DC auxiliary output

| Range | Voltage | Max. current |
|--------------|---------|--------------|
| 20-130 V DC | 130 V | 0.4 A |
| 130-220 V DC | 220 V | 0.4 A |

Timer

Display options: In seconds or in mains-voltage periods.
Seconds: Range: 0.000-99999.9 s. Accuracy: 1 ms.
Periods: Range: 0.0-4999995 cycles at 50 Hz or 0.0- 5999994 cycles at 60 Hz. Accuracy: 0.1 cycles.
Max. input voltage: 250 V AC or 275 V DC

Ammeter

Ranges: Internal range: 0.00-250.0 A. External range: 0.000-6.000 A.
Accuracies: Internal range: 1%. External range: 1% for AC and 0.5% for DC.
Measurement method: True RMS for AC or average for DC.
Display option: Reading can be displayed as a percentage of a presettable nominal value if so desired.
Max. current, ext. input: 6 A AC or DC

Voltmeter

Range: 0.00-600.0 V
Accuracy: 1% for AC and 0.5% for DC
Measurement method: True RMS for AC or average for DC.
Display option: Reading can be displayed as a percentage of a presettable nominal value if so desired.
 The voltmeter can also be used as a 2nd ammeter.
Max. input voltage: 600 V AC or DC

Extra entities

AC: Z (Ω , ϕ), Z (Ω), R, X (Ω , Ω), S (VA), Q (VAR), $\cos \phi$, ϕ ($^\circ$), Iref), and ϕ ($^\circ$, Uref).
DC: R (Ω) and P (W).

| Entity | Range | Accuracy |
|-----------------------|-----------------------|------------------|
| Cos ϕ (cap, ind) | -0.99 to + 0.99 | \pm 0.04 |
| Phase angle | 000-359 $^\circ$ | \pm 2 $^\circ$ |
| Other entities | Up to 999 kX (X=unit) | |

Make/Break contact

Max. current: 1 A
Max. voltage: 250 V AC or 120 V DC
 The make/break contact is protected with a 1 A miniature circuit breaker.

Reclosing tests

Items measured: Tripping times and reclosing times.
Display: After test is finished a list of all times appears in display.
Breaker state feedback: The make/break contact can be used to feed back the breaker state.
Max. number of reclosings: 49
Max. testing time: 999 s

Set of resistors and a capacitor

Resistors: 0.5 Ω to 2.5 k Ω
Capacitor: 10 μ F, max. voltage 450 V AC (SVERKER 750)

Other

Application field: The instrument is intended for use in high-voltage substations and industrial environments.
Languages in menu: English, German, French, Spanish and Swedish.
Mains voltage: 230 V AC or 115 V AC \pm 10%, 50-60 Hz
Dimensions instrument: 350 x 270 x 220 mm (13.8" x 10.6" x 8.7")
Dimensions transport case: 610 x 290 x 360 mm (24.0" x 11.4" x 14.2")
Weight: 18 kg (39 lbs). 27 kg (59 lbs) with accessories and transport case.
Test lead set: With touch-proof contacts. 2 x 0.25 m (10")/2.5 mm², 2 x 0.50 m (20")/2.5 mm², 8 x 2.0 m (80")/2.5 mm² and 2 x 3.0 m (120")/10 mm² (with spade-tongue connectors).
Operating temperature: 0 to +50 $^\circ$ C (+32 to +122 $^\circ$ F)
Storage temperature: -40 to +70 $^\circ$ C (-40 to +158 $^\circ$ F)
Warranty: 1 year

SVERKER 750/760 is designed to comply with EU standards in accordance with IEC 1010 directive and the EU EMC directives.

The above specifications are valid at nominal input voltage and an ambient temperature of +25 $^\circ$ C (+77 $^\circ$ F). Specifications are subject to change without notice.

OPTIONAL ACCESSORIES

CSU20A

Current and Voltage Source

CSU20A is a small light-weight current and voltage source primarily intended to work together with the SVERKER 750/760 Relay Testing Unit when testing differential relays. Using the CSU20A together with SVERKER 750/760 gives the user two independent current sources, and the timer/measurement section in SVERKER 750/760 is used both for measuring the two outputs as well as measuring the trip time of the relay.

Besides testing differential relays the unit can be used as a multi-purpose AC/DC source. The CSU20A features one AC current/voltage output, one fully rectified DC output and one half-wave rectified DC output for harmonic restraint testing.

Other features are a current measurement shunt, selectable current/voltage ranges and an AC mains input/output. Connecting the SVERKER 750/760 mains to the mains output of the CSU20A gives an in-phase synchronization of the two units.

Specifications CSU20A

Outputs

| AC current | Minimum output voltage | Load time |
|---------------------|------------------------|------------|
| 20 A setting | | |
| Idle/non-load | 26 V | Continuous |
| 5 A | 25 V | Continuous |
| 10 A | 22 V | Continuous |
| 20 A | 18 V | 2 min |
| 10 A setting | | |
| Idle/non-load | 52 V | Continuous |
| 3 A | 50 V | Continuous |
| 5 A | 47 V | Continuous |
| 10 A | 41 V | 10 min |

DC current: As above, less the voltage drop over the rectifying diodes.

Current measurements: Current shunt 0.1 A / 1 V, \pm 2%
Mains voltage: 230 V AC or 115 V AC \pm 10%, 50-60 Hz
Operating temperature: -20 to +50 $^\circ$ C (-4 to +122 $^\circ$ F)

Thermal protection: Built-in

Dimensions: 280 x 178 x 246 mm (11" x 7" x 9.7")

Weight: 5.9 kg (13 lbs), excl. transport case

Warranty: 1 year

The above specifications are valid at nominal input voltage and an ambient temperature of +25 $^\circ$ C (+77 $^\circ$ F). Specifications are subject to change without notice.

PSS750

Phase Selector Switch

The PSS750 is specifically designed to work with SVERKER 750/760 when testing three-phase relays. It is connected between SVERKER 750/760 and the relay inputs and allows the user to easily select which phase to test.

The PSS750 handles both the current and voltage sources and single-phase or phase-phase testing can be selected. Together with the output-input switching the unit also contains a variable resistor that can be used together with the built-in capacitor in SVERKER 750/760. This feature gives the user the possibility to create a variable phase shift at a decreased amplitude of the test voltage.

The design is passive which makes it very general. You may for example use any of the inputs for current or voltage as long as you do not exceed the specification. It is also possible to connect the measuring inputs of the SVERKER 750/760 to the PSS750 and use the switch for selecting measurement signals.

The PSS750 simplifies phase switching, selecting type of fault, phase reversing and gives a possibility to create a variable phase shift.

Application example

1. Connect the current and voltage outputs of SVERKER 750/760 to the PSS750 inputs.
2. Connect the current and voltage inputs of the relay to the PSS750 outputs.
3. Select which phase to test and type of test (phase-to-ground or phase-phase) with the selector switch.
4. Proceed with the test for each phase and fault type.
5. To create a phase shift, connect the 10 μF capacitor in SVERKER 750/760 in series between the voltage output and the PSS750 input, and connect the variable resistor in parallel with the PSS750 input.
6. Set the SVERKER 750/760 for phase (and impedance) measurement. Connect the voltage measurement input to the PSS750 input.
7. Start the test with the resistor in maximum position. Gradually decreasing the resistor gives increasing phase shift in the voltage signal. The test voltage/impedance will decrease at the same time so an adjustment of the test current might be necessary to get the correct impedance. Please observe that the phase shift depends on the input resistance and may vary between different relays. Some relays may also have a low voltage limit where the relay will not operate. For additional 180 degrees phase shift use the phase reversal switch.

Specifications PSS750

Max input voltage: 250 V AC / 3 A

Max input current: 6 A / 250 V AC

Max resistor loading: 200 V AC / 200 mA (0.5 A during 5 seconds)

Dimensions: 200 x 120 x 85 mm (7.9" x 4.7" x 3.3")

Weight: 1.3 kg (2.9 lbs)

The above specifications are valid at nominal input voltage and an ambient temperature of +25°C (+77°F).

Specifications are subject to change without notice.



CSU20A



PSS750

SVERKER Win

PC software for SVERKER 750/760

The SVERKER Win (formerly ProView PC750) software makes fieldwork easier while providing neater reports. The SVERKER Win software enables you to control the SVERKER from a PC. The SVERKER is connected to the PC's serial port. Test results can be reported either directly with table and graph, or from an external program, e.g. Microsoft® EXCEL.

In SVERKER Win we have implemented the same report tool as in FREJA Win, which enables customised reports in an easy way. Hand-written drafts are now a thing of the past!

Another new feature is the reference graphs, together with the current/voltage graph presentation for each test point during the test. The graph can of course be printed out on the test report if you like.


During relay testing, each measured value is stored in a log list. In this list you can add comments to each test point. When the entire test is finished, you can save everything as a data file. Later, you can print out the test results. You save time by not having to write your report in the field. All report writing can be done conveniently back at the office.

The SVERKER Win software provides easy access to connection instructions, test instructions and the like, which you prepare in advance. These instructions, which can contain both text and graphics, can be prepared using standard word processing packages.

The settings you make on SVERKER are also saved in a file, so that the next time you want to test the same or a similar protective relay equipment, all you have to do in order to setup the SVERKER, is to open the file.

Specifications SVERKER Win

The SVERKER Win software comprises a 32-bit program written to run under Windows® 95/98/2000/NT. We recommend a Pentium® computer with at least 16 MB of RAM. The amount of space needed to save reports and settings will depend on how many protective systems that are to be tested. Roughly estimated, you will thus need a total of about 20-100 MB of free space on the hard disk.

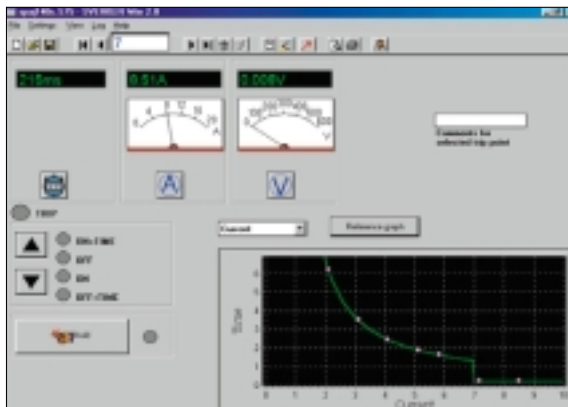

SVERKER Win

ORDERING INFORMATION

SVERKER 750 Relay Test Unit

Complete with test lead set GA-00030 and transport case GD-00182.

Mains voltage: 115 V

Art.No: CD-11190

Mains voltage: 230 V

Art.No: CD-12390

SVERKER 760 Relay Test Unit

Complete with test lead set GA-00030 and transport case GD-00182.

Mains voltage: 115 V

Art.No: CD-21190

Mains voltage: 230 V

Art.No: CD-22390

Optional accessories

SVERKER Win PC Software

SVERKER Win contains software, a copy-protection key and a cable used to connect the PC to SVERKER.

SVERKER Win is available in English, Czech, German and Swedish. Please specify language when ordering. Specify the SVERKER serial number.

Art.No: CD-8102X

Note that the software key can be installed on a single SVERKER. The software itself, however, can be installed on an unlimited number of PCs. No spreadsheet program (e.g. Microsoft® EXCEL) is included with SVERKER Win.

SVERKER Win Upgrade

Art.No: CD-8101X

SVERKER 750/760 PROM update

(SVERKER Win requires PROM-version R04A or higher.).

PROM update done by Ge Energy Services.

Art.No: CD-89010

PROM update done by customer.

Art.No: CD-89011

CSU20A Current And Voltage Source

Complete with cables and transport case.

Mains voltage: 115 V

Art.No: BF-41190

Mains voltage: 230 V

Art.No: BF-42390

PSS750 Phase Selector Switch

Art.No: CD-90020



Test lead set

1 Set of resistors

Fine regulation of current and voltage are easy thanks to the built-in set of resistors.

2 Display

Presents time, current, voltage and other entities. Also used to make many setting, after you enter the setting mode by pressing button marked MODE.

3 Freeze function (HOLD)

This makes it possible to measure voltages and current as short as a quarter of a mains-voltage period by immobilizing the reading on the display. Voltage and current readings are frozen when the timer stops. If the timer does not stop, the reading present when the current was interrupted is frozen on the display.

7 Start switch

Controls the turning on and off of the current source and timer. Can be set to one of four states. ON+TIME. Starts generation and timing simultaneously. Used to test over... relays (...means current, voltage or some other entity). Generation continues a) until the protective relay equipment operates and stops the timer or b) until the maximum time expires or the start switch is released if time-limited generation has been selected. OFF. Turns off the current source, whereupon generation is interrupted. ON. Turns on the current source in the generating state. OFF+TIME. Interrupts generation and starts the timer simultaneously. Used when testing under ...relays (...means current, voltage or some other entity). The timer is stopped when the protective relay equipment operates. When automatic reclosing is to be tested, SVERKER can be set so that new generation will start when the timer's start input is activated by the closing command.

11 Ammeter and voltmeter

Current and voltage are measured by the built-in ammeter and voltmeter. Resistance, impedance, phase angle, power and power factor can also be measured. Readings appear on the display. These instruments can also be used to take measurements in external circuits. The voltmeter can also be used as a 2nd ammeter (when testing differential relays for example). Current and voltage can be displayed either as amperes and volts or as percentages of a given current or voltage (the present settings of the protective relay equipment for example).

12 Auxiliary voltage source

Provides 20-220 V DC in two ranges. Equipped with overload protection and separated from the other outputs. Used frequently to supply the object being tested.



4 Start and stop conditions

The timer's start and stop inputs respond to changes, voltage or contact closing/openings. The timer's start input is also used when testing auto-reclosing relays, to synchronize two or more SVERKER units and to start generation with an external signal.

5 Status indicator

The timer's start and stop inputs are each equipped with indicator lamps which, when lighted, indicate a closed circuit (useful for detecting contact closings/openings) or the presence of voltage. These indicator lamps make it possible (for example) to check circuits before starting a measurement cycle.

6 Timer inputs

The timer has separate start and stop inputs, and it can be used to measure both external cycles and sequences initiated by SVERKER. The measured time appears on the display. Each input can be set to respond to the presence or absence of voltage (AC or DC) at a contact.

8 Computer communication interface

SVERKER is equipped with a serial port for communication with personal computers and the PC software Sverker Win.

9 Make/break contact

Changes state automatically when a test is started. Can be used (for example) to synchronize two or more SVERKER units, other external equipment or to switch the voltage applied to the protective relay equipment back and forth between non-faulty and faulty.

10 Current source

Provides 0-250 A AC, 0-250 V AC or 0-300 V DC, depending on the output that is being used. Settings are made using the main knob. The readings of current, voltage and other entities appear on the display. The start switch is used to turn the current source on and off. When time is being measured, this is done in synchronization with the timer.

13 AC voltage source

Intended primarily for use with voltage inputs to the protective relay equipment. Can provide 0-140 V AC and 0-359° phase shift (SVERKER 760). Since the AC voltage source is separated from the other outputs, it can be set independently of the current source.

14 Tripping indicator

Lights when a stop condition is fulfilled to indicate operation of the protective relay equipment. If the test being conducted incorporates timing, this indicator starts to blink when relay operation occurs.

15 Main knob

Used to set current output from the current source.